

**KIT BASE INSTALLAZIONE  
SU SCATOLA ELETTRICA  
COD. 3.031013**

IT

**AVVERTENZE GENERALI.**

Tutti i prodotti Immergas sono protetti con idoneo imballaggio da trasporto. Il materiale deve essere immagazzinato in ambienti asciutti ed al riparo dalle intemperie.

Il presente foglio istruzioni contiene informazioni tecniche relative all'installazione del kit Immergas. Per quanto concerne le altre tematiche correlate all'installazione del kit stesso (a titolo esemplificativo: sicurezza sui luoghi di lavoro, salvaguardia dell'ambiente, prevenzioni degli infortuni), è necessario rispettare i dettami della normativa vigente ed i principi della buona tecnica.

L'installazione o il montaggio improprio dell'apparecchio e/o dei componenti, accessori, kit e dispositivi Immergas potrebbe dare luogo a problematiche non prevedibili a priori nei confronti di persone, animali, cose. Leggere attentamente le istruzioni a corredo del prodotto per una corretta installazione dello stesso.

L'installazione e la manutenzione devono essere effettuate in ottemperanza alle normative vigenti, secondo le istruzioni del costruttore e da parte di personale abilitato nonché professionalmente qualificato, intendendo per tale quello avente specifica competenza tecnica nel settore degli impianti, come previsto dalla Legge.

**COMPONENTI PRESENTI NEL KIT.**

Rif	Descrizione	Qtà
1	Base di supporto su scatola elettrica	1
2	Placca estetica di copertura	1
3	Viti di fissaggio	2


**INSTALLAZIONE KIT (FIG. 1).**

**N.B.:** su questa base è possibile installare indistintamente il modulo Gateway o il Cronotermostato Smartech Plus.

Per l'installazione procedere nel seguente modo:

- installare la base di supporto (1) sulla scatola elettrica (tipo 503) predisposta a parete fissandola con le 2 viti in dotazione (2);
- agganciare a pressione come indicato in figura la placca estetica di copertura (3);
- Cronotermostato (6); si aggancia (o si rimuove) a pressione sopra al supporto installato (1) con la placca estetica di copertura (3).
- Modulo Gateway (5); dopo aver fatto passare i cavi attraverso il foro centrale della base di supporto e della placca estetica e dopo averlo cablato (come descritto nel relativo foglio istruzioni) si aggancia a pressione sopra al supporto installato e infine bloccato con le due viti di fissaggio (4).

**MONTAGGIO**

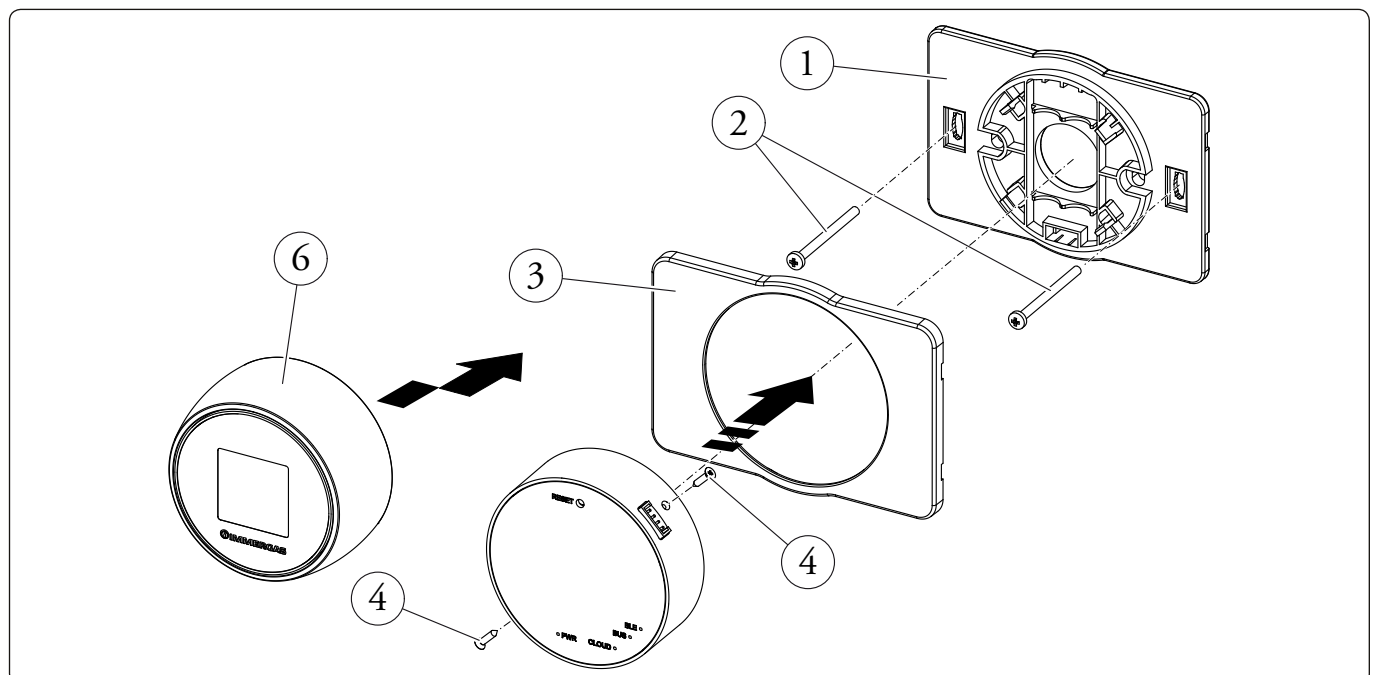

**BASE INSTALLATION KIT  
ON ELECTRIC BOX  
CODE 3.031013**

IE

**GENERAL WARNINGS.**

All Immergas products are protected with suitable transport packaging.

The material must be stored in a dry place protected from the weather.

This instruction manual provides technical information for installing the Immergas kit. As for the other issues related to kit installation (e.g. safety in the workplace, environmental protection, accident prevention), it is necessary to comply with the provisions specified in the regulations in force and with the principles of good practice.

Improper installation or assembly of the Immergas appliance and/or components, accessories, kits and devices can cause unexpected problems for people, animals and objects. Read the instructions provided with the product carefully to ensure proper installation.

Installation and maintenance must be performed in compliance with the regulations in force, according to the manufacturer's instructions and by professionally qualified staff, meaning staff with specific technical skills in the plant sector, as envisioned by the law.

**KIT COMPOSITION.**

Ref	Description	Qty
1	Support base on electric box	1
2	Decorative cover plate	1
3	Fixing Screws	2

**KIT INSTALLATION (FIG. 1).**

**N.B.:** on this base it is possible to install the Gateway module or the Smartech Plus Chrono-thermostat without distinction.

To install proceed as follows:

- install the support base (1) on the wall-mounted electrical box (type 503) and fix it with the 2 screws provided (2);
- press-couple the decorative cover plate (3) as shown in the figure;
- Chrono-thermostat (6); it press-couples (or removes) above the installed support (1) to the decorative cover plate (3).
- Gateway module (5); after the cables have passed through the central hole of the support base and the decorative plate and once it has been wired (as described in the relevant instruction sheet) it is press-coupled onto the installed support and finally locked with the two fixing screws (4).

**ASSEMBLY**